

SPLIT TYPE ROOM AIR CONDITIONER INSTALLATION MANUAL

(PART NO. 9307698019-01)

For authorized service personnel only.












⚠ WARNING

- (1) For the room air conditioner to operate satisfactory, install it as outlined in this installation manual.
- (2) Connect the indoor unit and outdoor unit with the air conditioner piping and cords available standards parts. This installation manual describes the correct connections using the standard accessories and the parts specified in this installation manual.
- (3) Have installation work done by authorized service personnel only.
- (4) Never cut the power cord, lengthen or shorten the cord, or change the plug.
- (5) Also do not use an extension cord.
- (6) Plug in the power cord plug firmly. If the receptacle is loose, repair it before using the room air conditioner.
- (7) Do not turn on the power until all installation work is complete.

- Be careful not to scratch the air conditioner when handling it.
- After installation, explain correct operation to the customer, using the operating manual.
- Let the customer keep this installation manual because it is used when the air conditioner is serviced or moved.
- The maximum length of the piping is 10 m. The maximum height difference of the piping is 5 m. If the units are further apart than these, correct operation can not be guaranteed.

STANDARD ACCESSORIES

The following installation accessories are supplied.
Use them as required.

Name and Shape	Q'ty	Name and Shape	Q'ty
 Wall hook bracket	1	Tapping screw (small) ($\phi 3 \times 12$) 	2
		Hexagon wrench 	1
 Wall cap-B	1	Drain pipe 	1
		Remote control unit holder 	1
 Remote control unit	1		
 Battery	2	Cloth tape 	1
		Tapping screw (big) ($\phi 4 \times 25$) 	8
		Seal A 	1

This installation manual refers to following installation parts

Name	Q'ty
Connection pipe assembly	1
Connection cord (4-conductor)	1
Wall pipe	1
Decorative tape	1
Vinyl tape	1
Wall cap	1
Saddle	1 set
Drain hose	1
Tapping screws	1 set
Sealant	1

ELECTRICAL REQUIREMENT

Always make the air conditioner power supply a special branch circuit and provide a special switch and receptacle. Do not extend the power cord.

SELECTING THE MOUNTING POSITION

Decide the mounting position with the customer as follows:

1. INDOOR UNIT

- (1) Install the indoor unit level on a strong wall which is not subject to vibration.
- (2) The inlet and outlet ports should not be obstructed : the air should be able to blow all over the room.
- (3) Install the unit near an electric outlet or special branch circuit.
- (4) Do not install the unit where it will be exposed to direct sunlight.
- (5) Install the unit where connection to the outdoor unit is easy.
- (6) Install the unit where the drain pipe can be easily installed.
- (7) Take servicing, etc. into consideration and leave the spaces shown in (Fig. 2). Also install the unit where the filter can be removed.

2. OUTDOOR UNIT

- (1) If possible, do not install the unit where it will be exposed to direct sunlight. (If necessary, install a blind that does not interfere with the air flow.)
- (2) Do not install the unit where a strong wind blows or where it is very dusty.
- (3) Do not install the unit where people pass.
- (4) Take you neighbors into consideration so that they are not disturbed by air blowing into their windows or by noise.
- (5) Provide the space shown in Fig. 2 so that the air flow is not blocked. Also for efficient operation, leave open three of the four directions front, rear, and both sides.
- (6) Since the drain water flows from the outdoor unit during heating operation, when it is installed at a high place, install the drain pipe as shown in (Fig. 4) and connect it to a 16 mm (inside diameter) hose available anywhere. (Fig. 4)

⚠ WARNING

Install at a place that can withstand the weight of the indoor and outdoor units and install positively so that the units will not topple or fall.


⚠ CAUTION

- (1) Do not install where there is the danger of flammable gas leakage.
- (2) Do not install near heat sources.
- (3) If children under 10 years old may approach the unit, take preventive measures so that they cannot reach the unit.

[Indoor unit piping direction]


The piping can be connected in the five directions indicated by ①, ②, ③, ④, and ⑤ in (Fig. 1). When the piping is connected in direction ② or ⑤, cut along the piping groove in the side of the front cover with a hacksaw. When connecting the piping in direction ③, cut a notch in the thin wall at the front bottom of the front cover.

Fig. 1

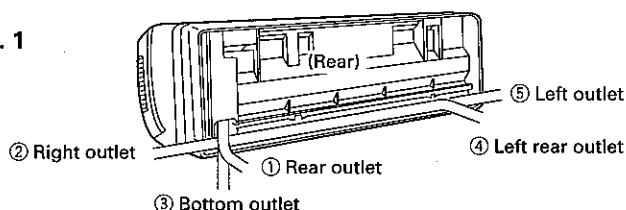

INSTALLATION DIAGRAM OF INDOOR AND OUTDOOR UNITS

Fig. 2 [INDOOR UNIT]

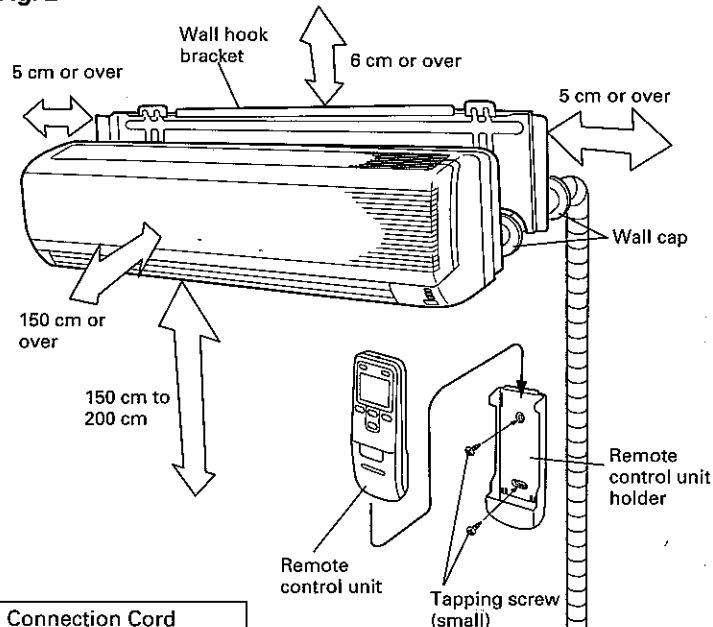

[OUTDOOR UNIT]

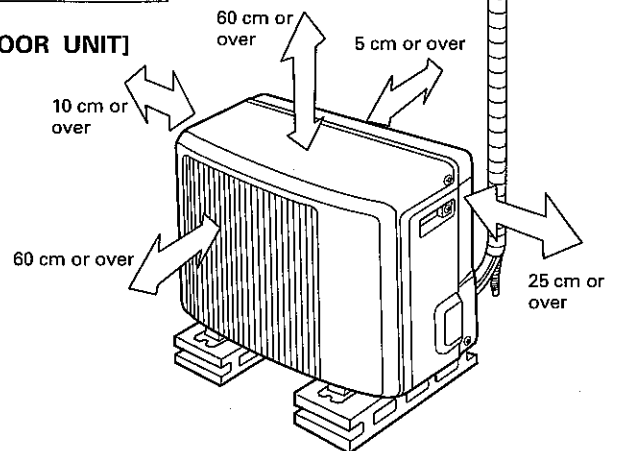


Fig. 3


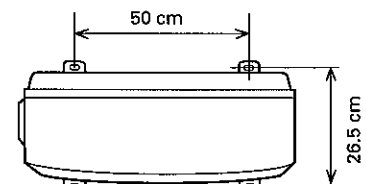


Fig. 4

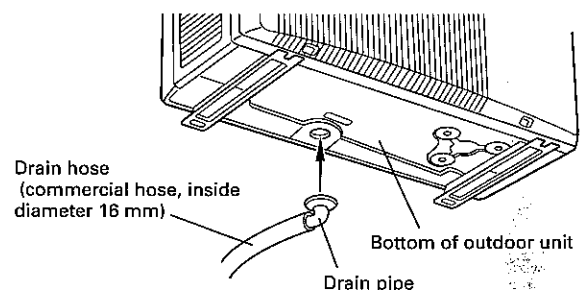

NOTE:

Do not install the drain pipe and drain hose in areas where the outside temperature drops to 0°C or below. Install where drain can be taken directly from the drain hole at the bottom of the outdoor unit.


- If the drain pipe and drain hose are installed, water in the pipe and hose may freeze and obstruct drainage and cause outdoor unit trouble.

INDOOR UNIT

CUTTING THE HOLE IN THE WALL FOR THE CONNECTING PIPING

- (1) Cut a 80 mm diameter hole in the wall at the position shown in (Fig. 5).
- (2) When cutting the wall hole at the inside of the wall hook bracket, cut the $\phi 80$ mm hole within the range of the left and right center marks. When cutting the wall hole at the outside of the wall hook bracket, cut the hole at least 10 mm below less.
- (3) Cut the hole so that the outside end is lower (5 to 10 mm) than the inside end.
- (4) Always align the center of the wall hole. If misaligned, water leakage will occur.
- (5) Cut the wall pipe to match the wall thickness, stick it into the accessory wall cap-B, fasten the cap with vinyl tape, and stick the pipe through the hole. (The connection pipe is supplied in the installation set.) (Fig. 5)
- (6) For left piping and right piping, cut the hole a little lower so that drain water will flow freely. (Fig. 5)

Fig. 5

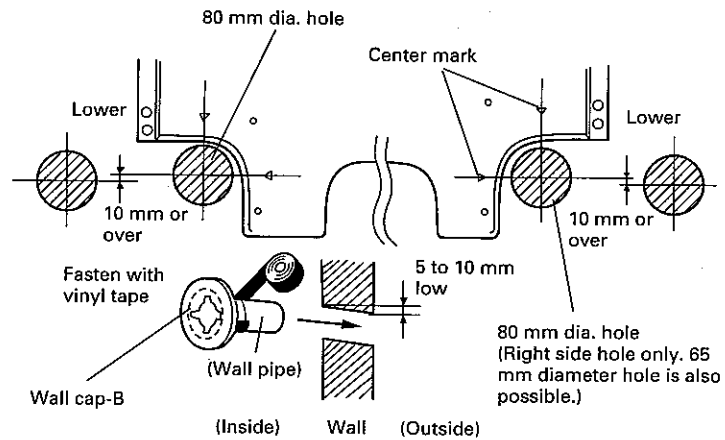


INSTALLING THE WALL HOOK BRACKET

- (1) Install the wall hook bracket so that it is correctly positioned horizontally and vertically. If the wall hook bracket is tilted, water will drip to the floor.
- (2) Install the wall hook bracket so that it is strong enough to withstand the weight of an adult.

Before fastening the wall hook bracket to the wall with the screws, level it by tapping the hook at the center of bracket to the wall with the handle of a screwdriver.

- Fasten the wall hook bracket to the wall with 6 or more screws through the holes near the outer edge of the bracket.
- Check that there is no rattle at the wall hook bracket.

Fig. 6

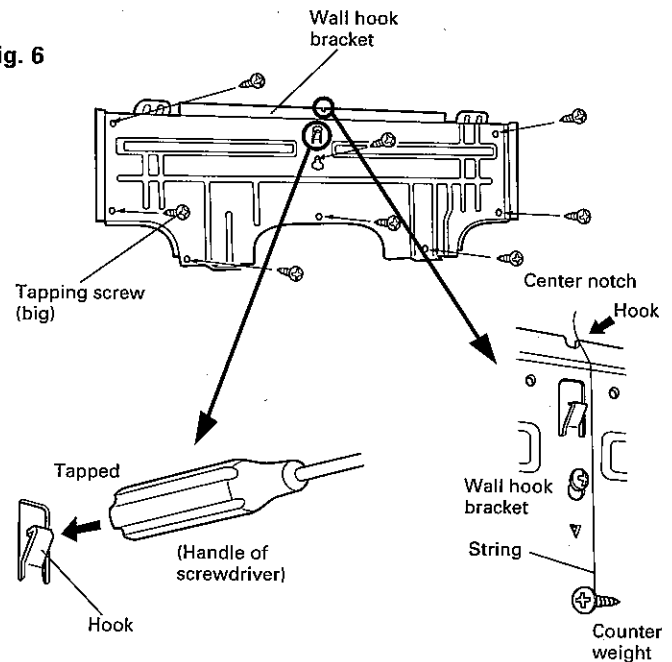

WARNING

If the wall pipe is not used, the cord interconnecting the indoor and outdoor units may touch metal and cause electric leakage.

CAUTION

Install the wall hook bracket horizontally and perpendicularly.

FORMING THE DRAIN HOSE AND PIPE


[Rear piping, Right piping, Bottom piping]

- Install the indoor unit piping in the direction of the wall hole and bind the drain hose and pipe together with vinyl tape. (Fig. 7)
- Install the piping so that the drain hose is at the bottom.
- Wrap the pipes of the indoor unit that are visible from the outside with decorative tape.

[For Left rear piping, Left piping]


Interchange the drain cap and the drain hose.

Fig. 7

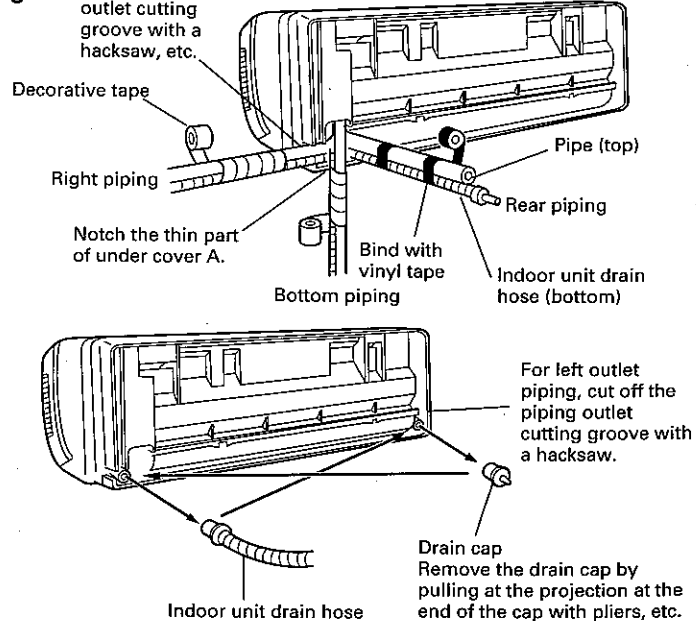

CAUTION

After removing the drain hose, do not forget to install the drain cap.

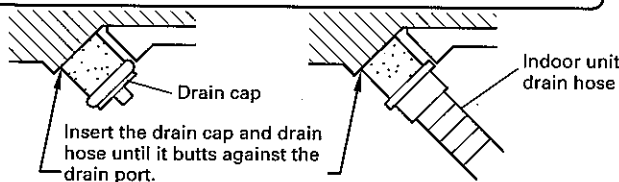

- For left piping and left rear piping, align the marks on the wall hook bracket and shape the connection pipe.
- Bend the connection piping at a bend radius of 70 mm or more and install no more than 35 mm from the wall.
- After passing the indoor piping and drain hose through the wall hole, hang the indoor unit on the hooks at the top and bottom of the wall hook bracket.

[Installing the indoor unit]

- Hang the indoor unit from the hooks at the top of the wall hook bracket.
- Insert the spacer, etc. between the indoor unit and the wall hook bracket and separate the bottom of the indoor unit from the wall.


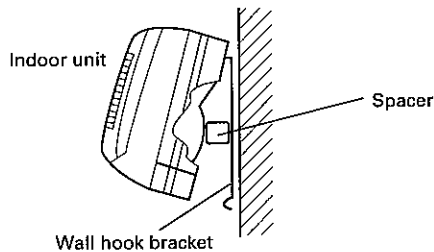


Fig. 8

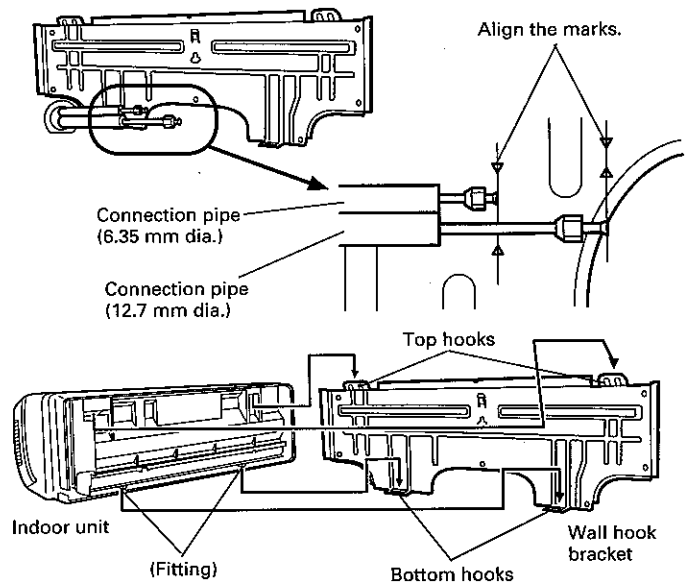

After hooking the indoor unit to the top hook, hook the fittings of the indoor unit to the two bottom hooks while lowering the unit and pushing it against the wall.

CONNECTING THE PIPING

CONNECTION

- (1) Install the outdoor unit wall cap (supplied with the optional installation set or procured at the site) to the wall pipe.
- (2) Connect the outdoor unit and indoor unit piping.
- (3) After matching the center of the flare surface and tightening the nut hand tight, tighten the nut to the specified tightening torque with a torque wrench. (Tighten the flare nut of the outdoor unit 3-way valve after air purging.)

FLARING

- (1) Cut the connection pipe to the necessary length with a pipe cutter.
- (2) Hold the pipe downward so that cuttings will not enter the pipe and remove the burrs.
- (3) Insert the flare nut onto the pipe and flare the pipe with a flaring tool.

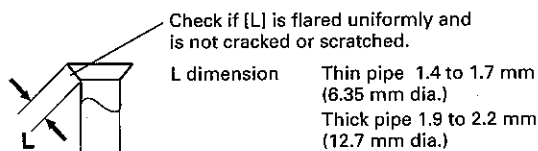


Fig. 9



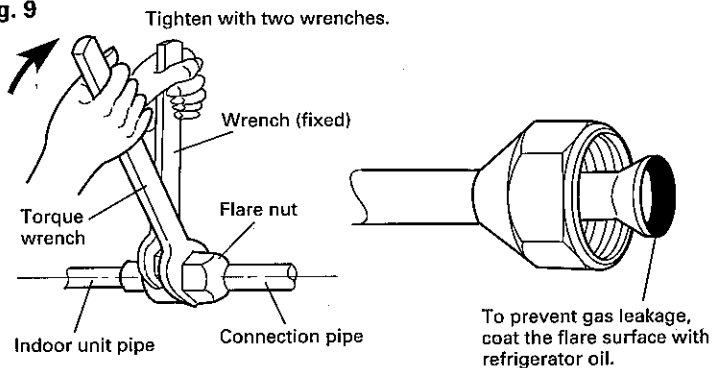


Table 1 Flare nut tightening torque

Flare nut	Tightening torque	Tightening torque standard (using a 20 cm wrench)
6.35 mm dia.	15.7 to 17.6 N·m (160 to 180 kgf·cm)	Wrist strength
12.7 mm dia.	49.0 to 53.9 N·m (500 to 550 kgf·cm)	Arm strength

INDOOR UNIT WIRING

- (1) Remove the cord clamp.
- (2) Bend the end of the connection cord as shown in the figure.
- (3) Stick the cable mark to the connection cord.
- (4) Connect the end of the connection cord fully into the terminal block.
- (5) Fasten the connection cord with a cord clamp.

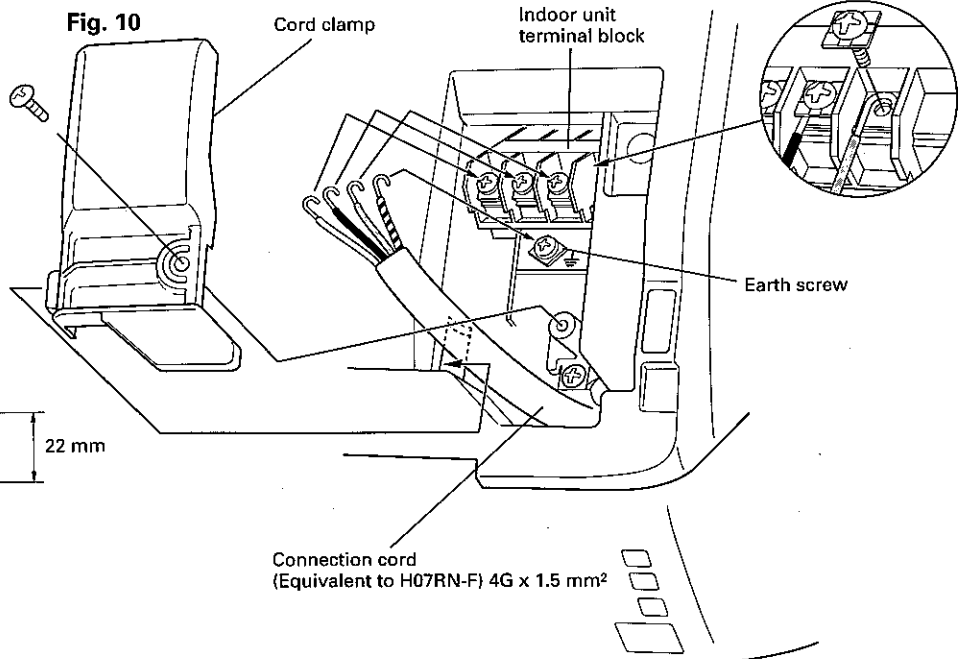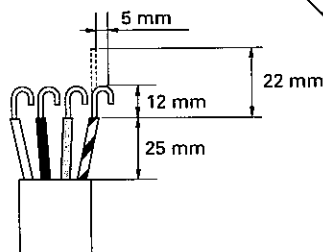

FINISHING

(1) Heat insulate the connections between pipes.

- For rear, right, and bottom piping, butt the connection piping insulation material against the indoor unit piping and fasten it with seal A and vinyl tape so there is no gap.
- For left and left bottom piping wrap the piping with cloth tape within the range that encompasses the piping housing section at the rear of the indoor unit.

(2) Push the bottom of the indoor unit against the wall and hook the two pawls at the bottom of the indoor unit to the mounting plate hooks. At this time, check the following:

- Are the top and bottom hooks seated positively? Check by moving the indoor unit forward, backward, left and right.
- Is the indoor unit installed level and perpendicular?
- For left rear piping, is the drain hose at the bottom of the wall hole pipe?



(3) Temporarily fasten the connection cable along the connection piping with vinyl tape and wrap decorative tape around the part that is visible from the body. For right, bottom, and left piping, securely wrap the part coming from the body with decorative tape so that the piping does not swell. (Overlap wrapping of outdoor parts about 1/3 of the width of the tape from the bottom of the piping so that water will not enter.)

(4) Fasten the connection pipe to the outside wall with a saddle, etc.



(5) Fill the gap between the outside wall pipe hole and the pipe with sealer so that rain water and wind cannot blow in.

(6) Fasten the drain hose to the outside wall, etc.



Fig. 11

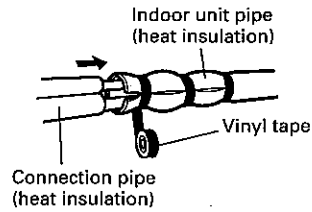


Butt connection pipe (heat insulation) against the indoor unit pipe (heat insulation) and wrap with seal A so that there is no gap.

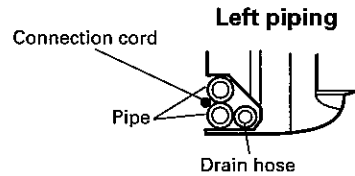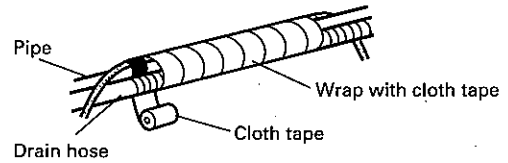

For connection from the left rear

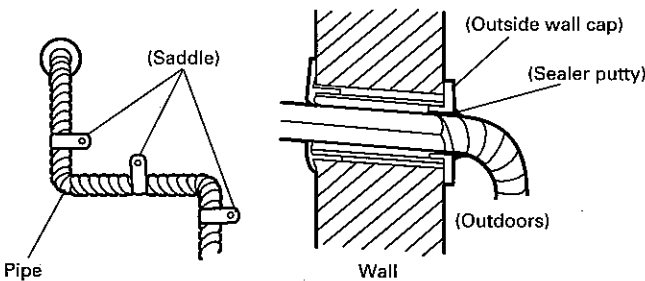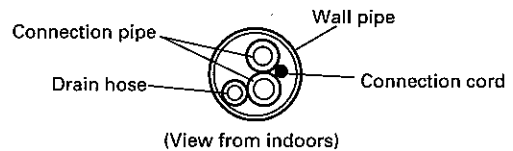

Check the following :

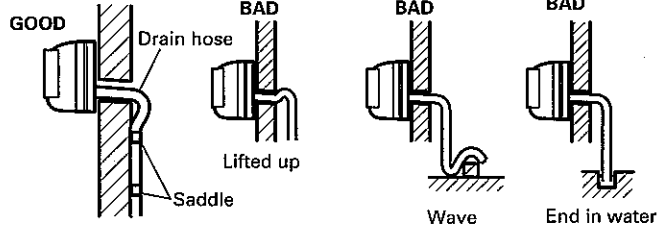

CAUTION

(1) Always connect the connection cord by matching the indoor unit and outdoor unit terminal block numbers. Erroneous wiring may cause sparking.

(2) Securely connect the connection cord to the terminal block. Imperfect connection may cause sparking.

(3) Always fasten the sheath of the connector cord with cord clamps.

(4) Always connect the power cord to earth.

(5) The earth screw in the figure is for the connection cord only. Do not use it for other applications.

OUTDOOR UNIT

OUTDOOR UNIT INSTALLATION

- Set the unit on a strong stand, such as one made of concrete blocks to minimize shock and vibration.
- Do not set the unit directly on the ground because it will cause trouble.

Connector cover removal

- Remove the two mounting screws.
- Put your hand on the back side (◻ mark) and take out the connector cover forwards.


Installing the connector cover

- (1) After inserting the three front hooks, then insert the rear hook.
- (2) Tighten the two mounting screws.

WARNING

- (1) Install the unit where it will not be tilted by more than 5°.
- (2) When installing the outdoor unit where it may be exposed to strong wind, fasten it securely.

Fig. 12

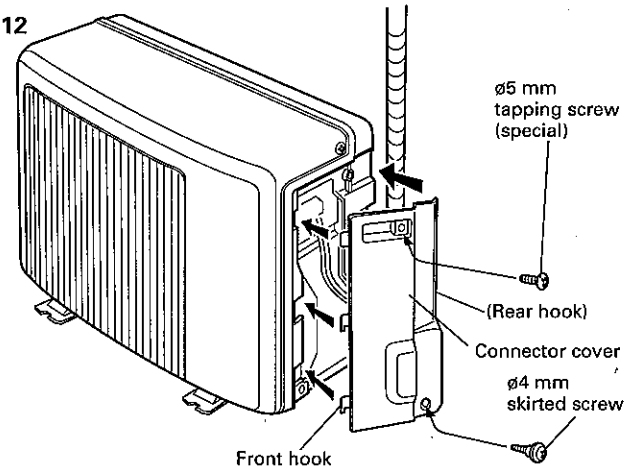

Always use the screws as shown above.
Do not select the top and bottom screws incorrectly.


AIR PURGE

Close the high pressure side valve of the gauge manifold fully and do not operate it during the following work.

1. Check if the piping connections are secure.
2. Check that the stems of 2-way valve and 3-way valve are closed fully.
3. Connect the gauge manifold service hose to the charging port of the 3-way valve (side with the projection for pushing in the valve core).
4. Open the low pressure side valve of the gauge manifold fully.
5. Operate the vacuum pump and start pump down.
6. Slowly loosen the flare nut of the 3-way valve and check if air enters, then retighten the flare nut.
(When the flare nut is loosened the operating sound of the vacuum pump changes and the reading of the compound pressure gauge goes from minus to zero.)
7. Pump down the system for at least 15 minutes, then check if the compound pressure gauge reads -100 kPa ($-76 \text{ cm} \cdot \text{Hg}$, -1 bar).
8. At the end of pump down, close the low pressure side gauge of the gauge manifold fully and stop the vacuum pump.
9. Slowly loosen the valve stem of the 3-way valve. When the compound pressure gauge reading reaches $1-2 \text{ kg/cm}^2$, retighten the valve stem and disconnect the service hose from the 3-way valve charging port.
(If the stem of the 3-way valve is opened fully before the service hose is disconnected, it may be difficult to disconnect the service hose.)

10. Fully open the valve stems of the 2-way valve and 3-way valve using a hexagon wrench. (After the valve stem begins to turn, turn it with a torque of less than $2.9 \text{ N} \cdot \text{m}$ ($30 \text{ kgf} \cdot \text{cm}$) until it stops turning.)
11. Firmly tighten the 2-way valve and 3-way valve blank cap and the charging port cap.

Fig. 13

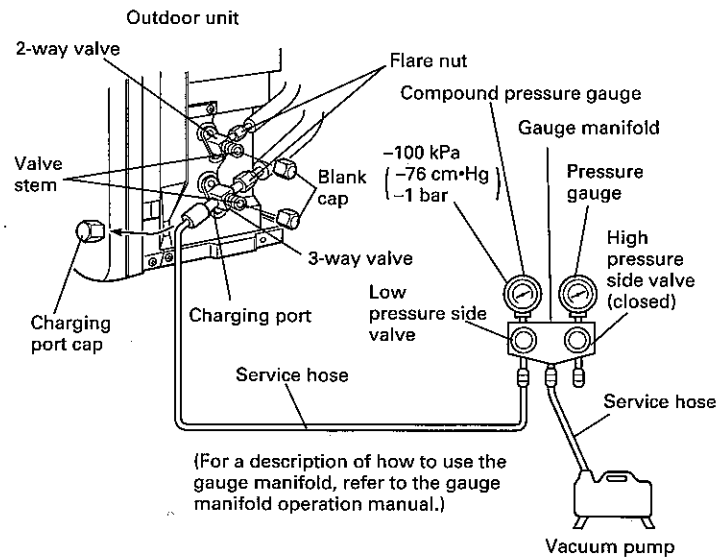

(For a description of how to use the gauge manifold, refer to the gauge manifold operation manual.)

Table 2

	Tightening torque
Blank cap (2-way valve)	19.6 to 24.5 N·m (200 to 250 kgf·cm)
Blank cap (3-way valve)	27.4 to 31.4 N·m (280 to 320 kgf·cm)
Charging port cap	12.3 to 15.7 N·m (125 to 160 kgf·cm)

ADDITIONAL CHARGE

Refrigerant suitable for a piping length of 5 m is charged in the outdoor unit at the factory.

When the piping is longer than 5 m, additional charging is necessary.

For the additional amount, see the table below.

Table 3

Pipe length	5 m	7 m	10 m
Additional refrigerant	None	32 g	80 g

Between 5 m and 10m, when using a connection pipe other than that in the table, charge additional refrigerant with 16 g/1 m as the criteria.



CAUTION

- (1) When moving and installing the air conditioner, do not mix gas other than the specified refrigerant (R22) inside the refrigerant cycle.
- (2) When adding refrigerant, add the refrigerant from the charging port at the completion of work.
- (3) The maximum length of the piping is 10 m. If the units are further apart than this, correct operation can not be guaranteed.
- (4) After connecting the piping, check the joints for gas leakage with gas leak detector.

OUTDOOR UNIT WIRING

- (1) Remove the outdoor unit connector cover.
- (2) Bend the end of the cord as shown in the figure.
- (3) Connect the end of the connection cord fully into the terminal block.
- (4) Fasten the sheath with a cord clamp.
- (5) Install the control box cover-B.
- (6) Install the connector cover.

Fig. 14

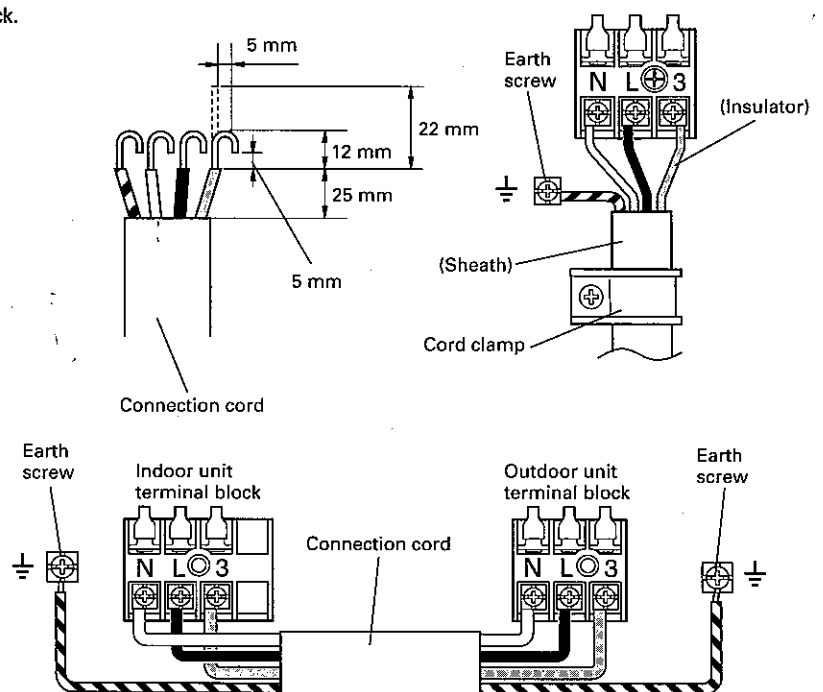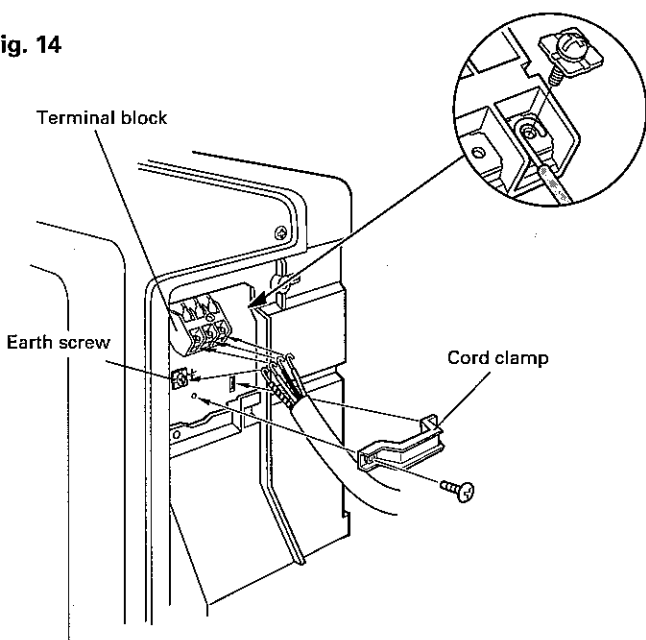


Connection cord wiring

Run the connection cord to the rear of the outdoor unit within the range of the arrows shown in the figure.

(To facilitate installation of the connector cover.)

Fig. 15

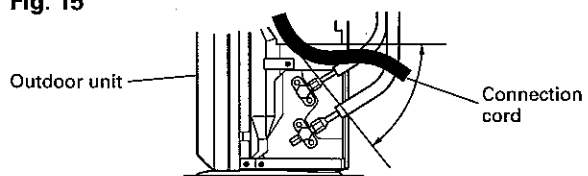


CAUTION

- (1) Always connect the connection cord by matching the indoor unit and outdoor unit terminal block numbers. Erroneous wiring may cause sparking.
- (2) Securely connect the connection cord to the terminal block. Imperfect connection may cause sparking.
- (3) Always fasten the sheath of the connector cord with cord clamps.
- (4) Always connect the power cord to earth.
- (5) The earth screw in the figure is for the connection cord only. Do not use it for other applications.

TEST RUNNING


- Perform test operation and check items 1 and 2 at the right.
- For the test operation method, refer to the operating manual.
- The outdoor unit, may not operate, depending on the room temperature. In this case, press the test run button on the rear of the remote control unit while the air conditioner is running. (Point the transmitter section of the remote control unit toward the air conditioner and press the test run button with the tip of a ball-point pen, etc.)
- To end test operation, press the remote control unit START/STOP button.

(When the air conditioner is run by pressing the test run button, the OPERATION indicator lamp and TIMER indicator lamp will simultaneously flash slowly.)

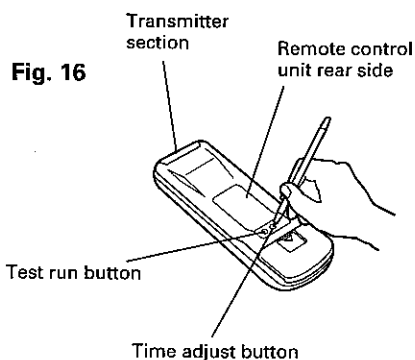

1. INDOOR UNIT

- (1) Is operation of each button on the remote control unit normal?
- (2) Does each lamp light normally?
- (3) Do the air flow-direction louver operate normally?
- (4) Is the drain normal?

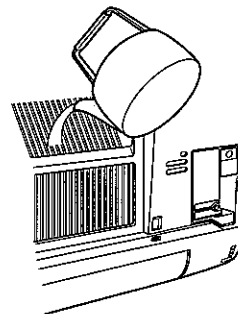

2. OUTDOOR UNIT

- (1) Is there any abnormal noise and vibration during operation?
- (2) Will noise, wind, or drain water from the unit disturb the neighbors?
- (3) Is there any gas leakage?

POWER

⚠ WARNING

- (1) The rated voltage of this product is 220-230V AC 50Hz.
- (2) Before turning on the power, check if the voltage is within the 220V - 10% to 230V + 10% range.
- (3) Always use a special branch circuit and install a special receptacle to supply power to the room air conditioner.
- (4) Use a circuit breaker and receptacle matched to the capacity of the air conditioner.
- (5) Do not extend the power cord.
- (6) Perform wiring work in accordance with standards so that the air conditioner can be operated safely and positively.
- (7) Install a leakage circuit breaker in accordance with the related laws and regulations and electric company standards.

⚠ CAUTION

- (1) The power source capacity must be the sum of the air conditioner current and the current of other electrical appliances. When the current contracted capacity is insufficient, change the contracted capacity.
- (2) When the voltage is low and the air conditioner is difficult to start, contact the power company the voltage raised.

CUSTOMER GUIDANCE

Explain the following to the customer in accordance with the operating manual:

- (1) Starting and stopping method, operation switching, temperature adjustment, timer, air flow switching, and other remote control unit operations.

- (2) Air filter removal and cleaning, and how to use the air louvers.
- (3) Give the operating and installation manuals to the customer.